

Exhibit 1



RULE 3206 REPORT
PROPOSED CONSTRUCTION OR
EXTENSION OF TRANSMISSION
FACILITIES

2009 THROUGH 2011

Case No. 6396
April 30, 2008



P.O. Box 840
Denver, Colorado
80201-0840

April 30, 2008

Mr. Doug Dean
Director
Colorado Public Utilities Commission
1560 Broadway, #250
Denver, CO 80202

Re: Case No. 6396
Public Service Company of Colorado
Rule 3206 Report For 2008

Dear Mr. Dean:

In compliance with Rule 3206 of the Commission's Rules Regulating the Service of Electric Utilities Public Service submits the attached schedule of proposed new construction or extension of transmission facilities for the calendar years 2009 through 2011.

Please forward questions concerning this report to Bill Wright at 303-294-2520.

Sincerely,

A handwritten signature in blue ink that reads 'Roy Palmer'. The signature is fluid and cursive, with the first name 'Roy' and last name 'Palmer' clearly distinguishable.

Roy Palmer
Executive Director, State Public Affairs

Attachment

Rule 3206 Report 2009 Through 2011

INDEX

<u>PROJECT</u>	<u>PAGE</u>
Horsethief 138kV Load Delivery and 138kV Transmission Line	5
Gunbarrel Substation.....	9
Comanche – Reader 115kV Underground Line #2	13
Clear Creek Substation and Clear Creek – Starkey Gulch 230kV Transmission Line.....	17
Kelim 115-13.8kV Substation	21
College Lake 115-13.8kV Substation	25
New Castle 115/69-24.9 kV Substation.....	29
Missile Site 230kV Switching Station.....	33
Niwot – Gunbarrel Load Service Request (LSR) 230kV Underground Line Project.....	37
Eldorado – Plainview – Ridge 115kV Line Removal/Rebuild Project.....	41
Eldorado – Valmont – Ridge 115kV Line Removal/Rebuild Project.....	45
San Luis – Walsenburg 230kV Line Project	49
Previously Filed Rule 3206 Projects.....	53
Rule 3206 Section (j) Projects – 2008	56

Missile Site

Public Service Company of Colorado Transmission Construction Project

Name of the project:

Missile Site 230kV Switching Station

Function of the project:

This project involves constructing a new 230kV Missile Site Switching Station approximately 40 miles east of Denver, sectionalizing the existing Pawnee – Daniels Park 230kV transmission line (#5457). The initial breaker station will be constructed on a new 35-40 acre site, and will consist of a 3-point ring bus switching station, designed to allow for future expansion into a full 345/230kV major substation. This substation has already been identified as required for two potential wind generation interconnection facilities, as well as a 230-115kV interconnection service point with Intermountain Rural Electric Association (IREA), PSCo's largest wholesale customer. This new station would also likely become an interconnection point for future 345kV transmission to the eastern and northern regions of Colorado. Please see Attachment H for an Orientation Map of the proposed project.

Estimated cost of the project:

\$3.0 million (Transmission Dollars)

Manner in which the project is expected to be financed:

2009 – 2013 approved capital budget.

Projected date for the start of construction of the project:

June 2009

Estimated date of completion of the project:

May 31, 2010

Estimated in-service date of the project:

May 31, 2010

Proposed general location:

Approximately 40 miles east of Denver, where the existing 230kV double circuit from Pawnee to Daniels Park transitions from an east-west alignment to a north-south alignment, creating a natural corner.

Prudent avoidance measures being evaluated for transmission facilities:

There will be no transmission lines for this project. All transmission facilities will be within the substation fence.

Attachment H

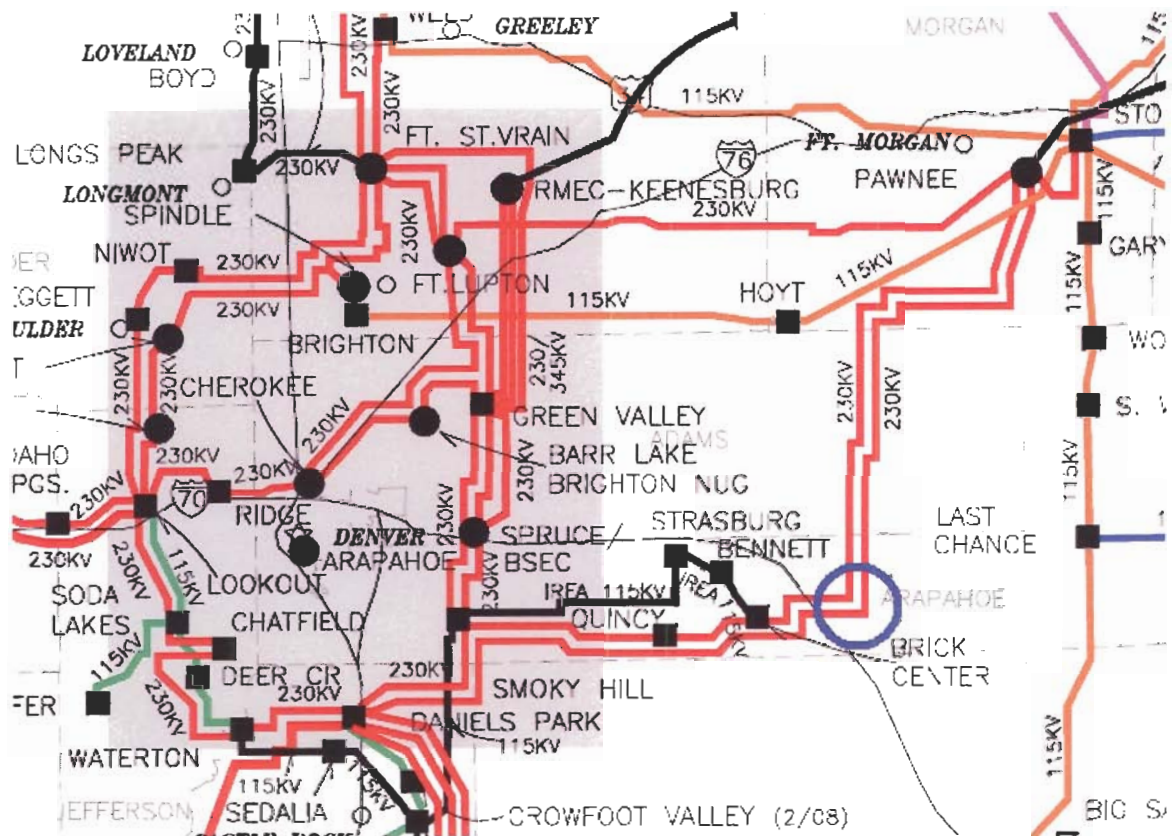


Figure 10: Proposed Location of Missile Site Switching Station

CERTIFICATE OF SERVICE

I hereby certify that on this 30th day of April 2008, the original and ten (10) copies of the foregoing **"RULE 3206 REPORT- PROPOSED CONSTRUCTION OR EXTENSION OF TRANSMISSION FACILITIES- 2009 THROUGH 2011 FOR PUBLIC SERVICE COMPANY OF COLORADO** were hand delivered to:


Doug Dean, Director
Colorado Public Utilities Commission
1560 Broadway, Suite 250
Denver, CO 80202

and a copy was hand delivered to:

James Greenwood
Director, Office of Consumer Counsel
1560 Broadway, Suite 200
Denver, CO 80203

and a copy was delivered via U.S. Mail to:

Bill Vidal
Manager of Public Works
201 W. Colfax, Dept. 608
Denver CO 80202

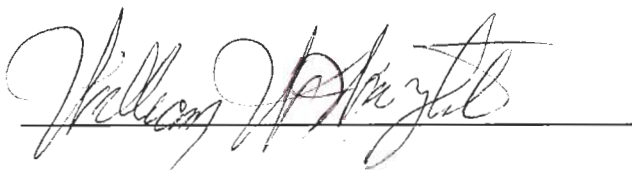A handwritten signature in cursive script, appearing to read "William H. Hartzel", is written over a horizontal line.