


Pawnee-Daniels Park 345kV Transmission Project

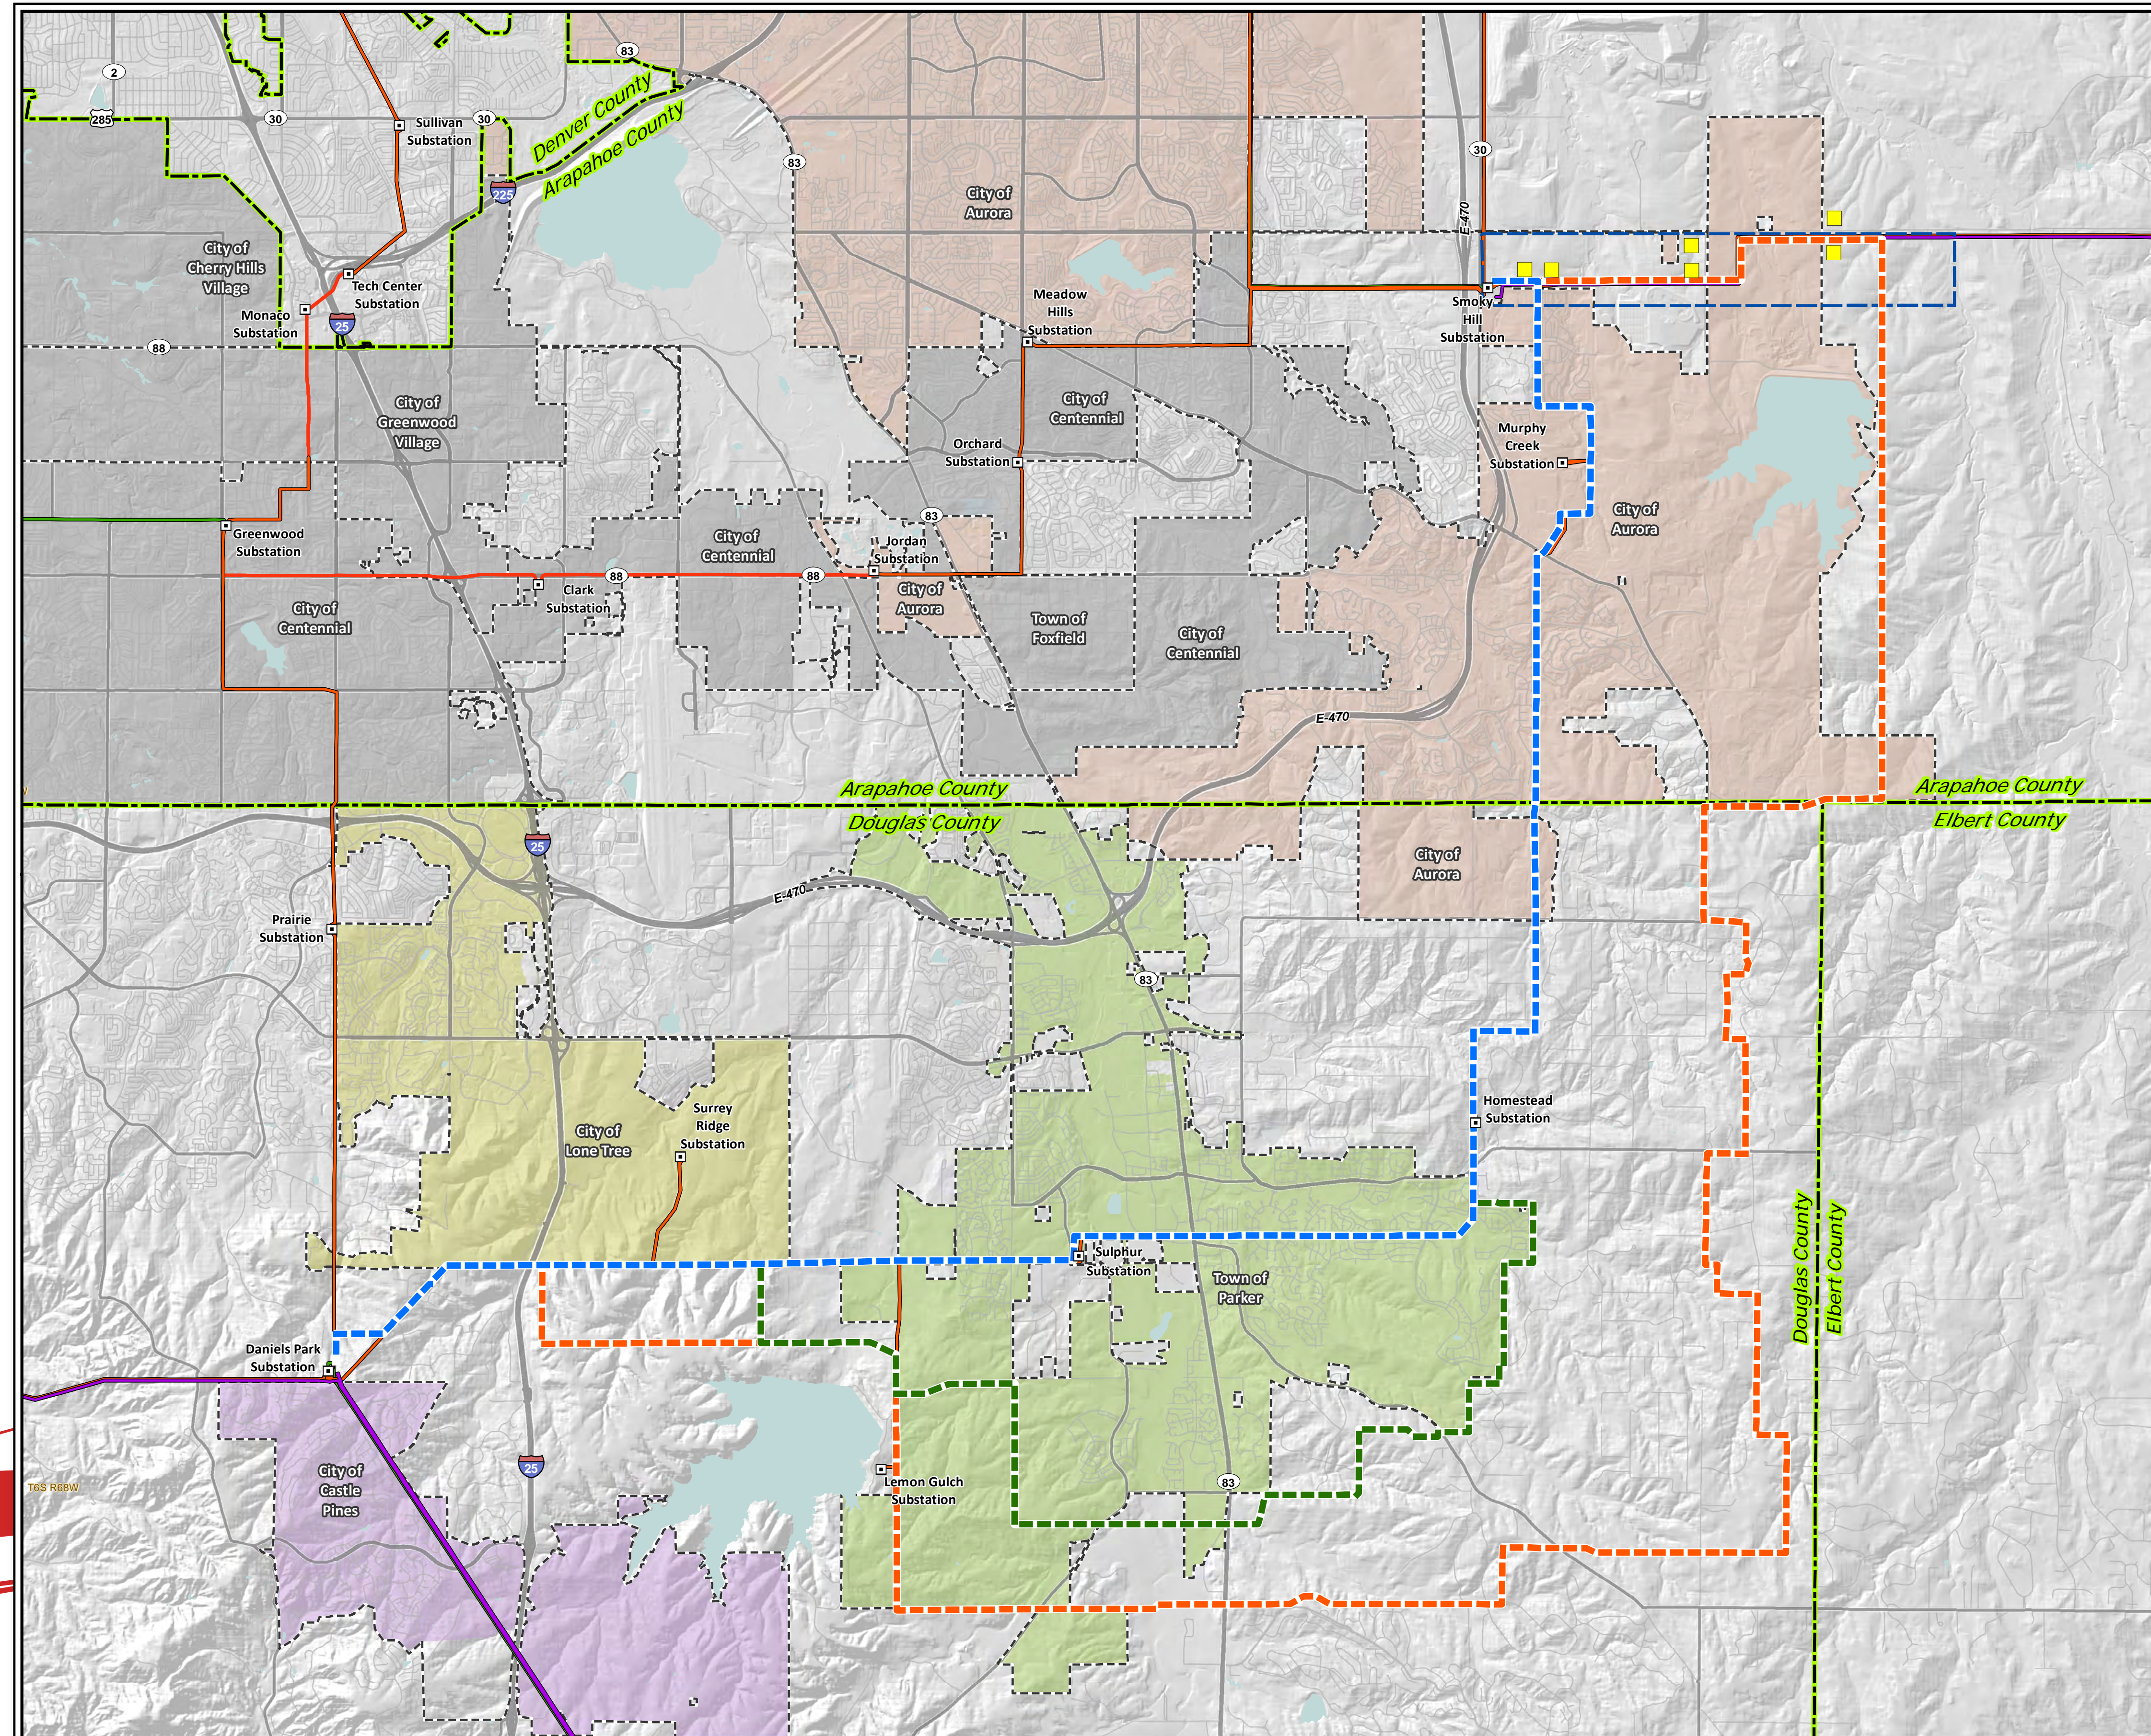

Proposed Smoky Hill to Daniels Park 345kV Line

Local Jurisdictions

- Route Alternative A
(existing transmission corridor)
- Route Alternative B
- Route Alternative C
- Possible Harvest Mile Substation Site
- County Boundary
- City Boundary

Existing Electric Transmission

- 345kV Overhead Transmission
- 230kV Overhead Transmission
- 230kV Underground Transmission
- 115kV Overhead Transmission
- Substation

