


POTENTIAL CORRIDORS & SUBSTATION SITING AREA

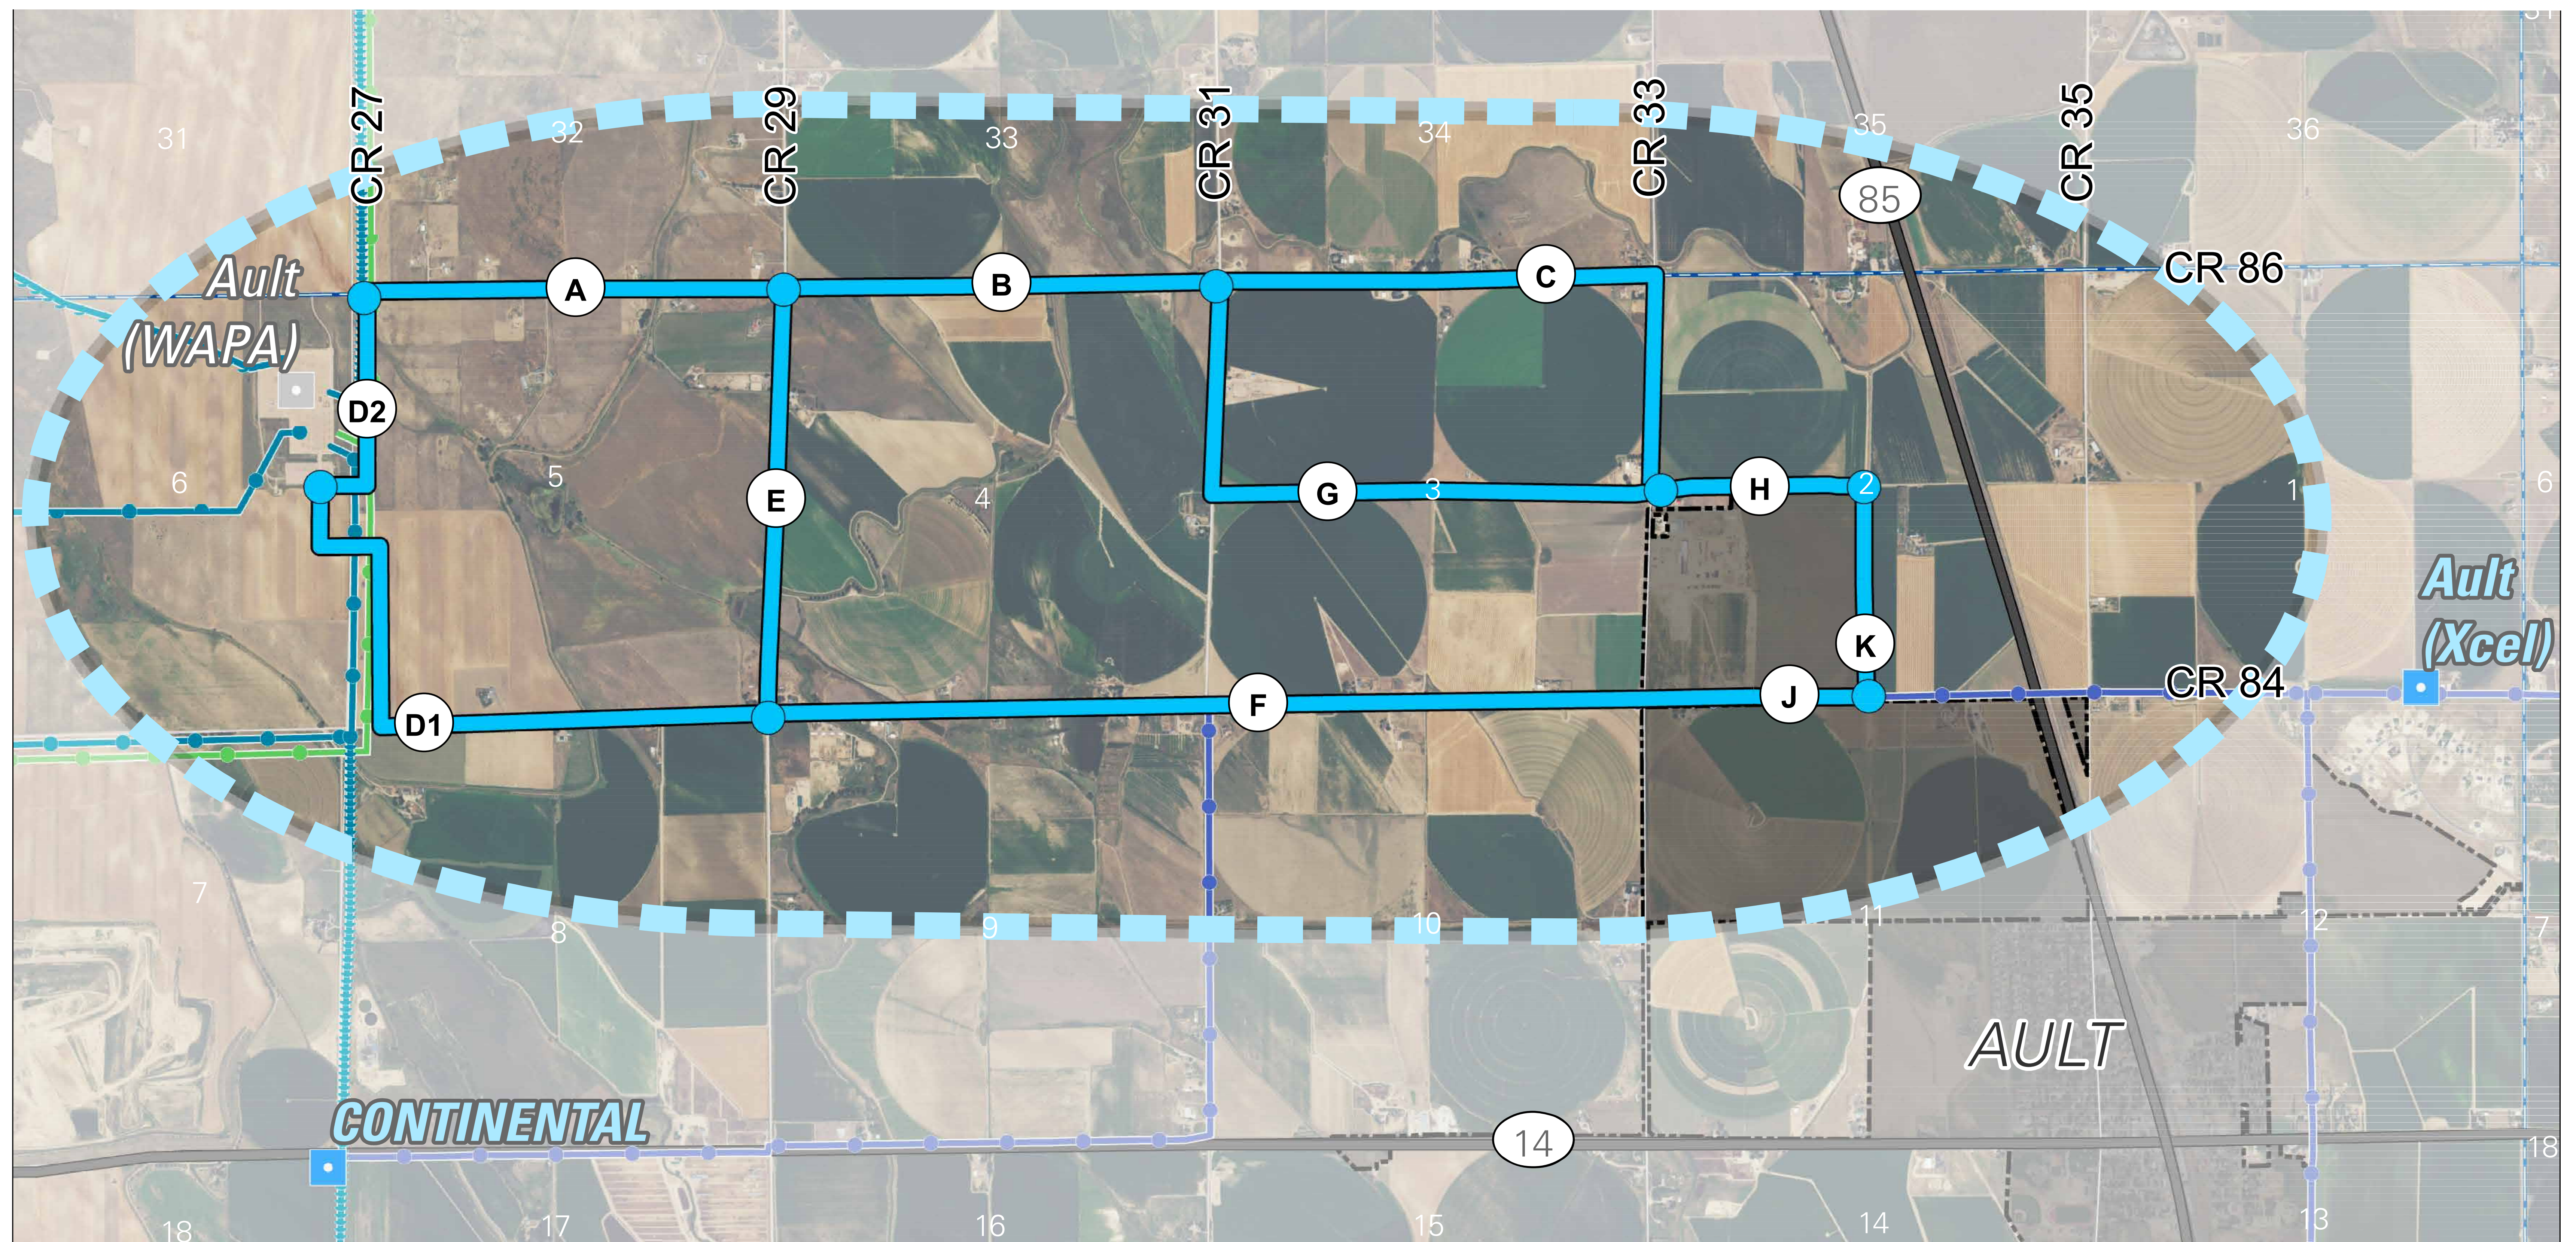

Existing
Transmission

- 230 kV
- 115 kV
- 44 kV

Proposed Transmission Alternatives

- Proposed Siting Area
- Ault to Husky Route Segment Alternatives

Substations

- PSCo Substation
- Other Substation

0 0.25 0.5 1 Miles

